

### TYPICAL SANITARY SEWER LATERAL & CLEAN-OUT DETAIL


NOT TO SCALE

#### SANITARY SEWER LATERAL NOTES:

1. IN ACCORDANCE WITH CODE RULE 753, IT IS THE CONTRACTORS' RESPONSIBILITY TO LOCATE ALL EXISTING SANITARY SEWER LATERALS WHERE THE "TOLERANCE ZONE" OVERLAPS THE WORK AREA. CONTRACTOR SHALL ASSURE BY HAND DIGGING THAT THE TOP OF EACH LATERAL IS AT LEAST 18" BELOW THE LOWEST POINT OF HIS EXCAVATION. IF THIS IS NOT THE CASE, CONTRACTOR SHALL NOTIFY E.I.C. AND CONCRETE ENCASE OR REPLACE LATERAL A.O.B.E.
2. ANY EXISTING SANITARY SEWER LATERAL DAMAGED DUE TO CONTRACTOR NONCOMPLIANCE WITH CODE 753 OR THE PLANS AND SPECIFICATIONS SHALL BE REPLACED WITH PVC. PIPE FROM THE MAIN TO A POINT MIDWAY BETWEEN THE THE CURB AND SIDEWALK (OR A.O.B.E.), WHERE A NEW CLEAN-OUT SHALL BE INSTALLED. WORK SHALL BE DONE AT THE CONTRACTOR'S EXPENSE.
3. WHERE SEWER MAINS ARE BEING REPLACED BY THE CONTRACTOR, HE SHALL ASSURE THAT ALL LATERALS (UNLESS CLEARLY ABANDONED) ARE CONNECTED TO THE NEW SEWER. IF AT LEAST ONE ACTIVE LATERAL IS NOT FOUND AT EACH PROPERTY, CONTRACTOR SHALL NOTIFY ENGINEER AND PROCEED AS DIRECTED. CONTRACTOR SHALL DETERMINE IF LATERALS ARE ACTIVE BY OBSERVING VISIBLE FLOW.
4. 100% NEW COMPACTABLE FILL FROM 12" BEHIND SIDEWALK TO MAIN.

ITEM 5 - TRENCH EXCAVATION

IN UNPAVED AREAS, TOP LIMIT FOR NEW COMPACTABLE FILL SHALL BE 6" BELOW EXISTING GROUND. THE TOP 6" SHALL BE APPROVED TOPSOIL AND SEEDING [ITEMS 121A & 123]

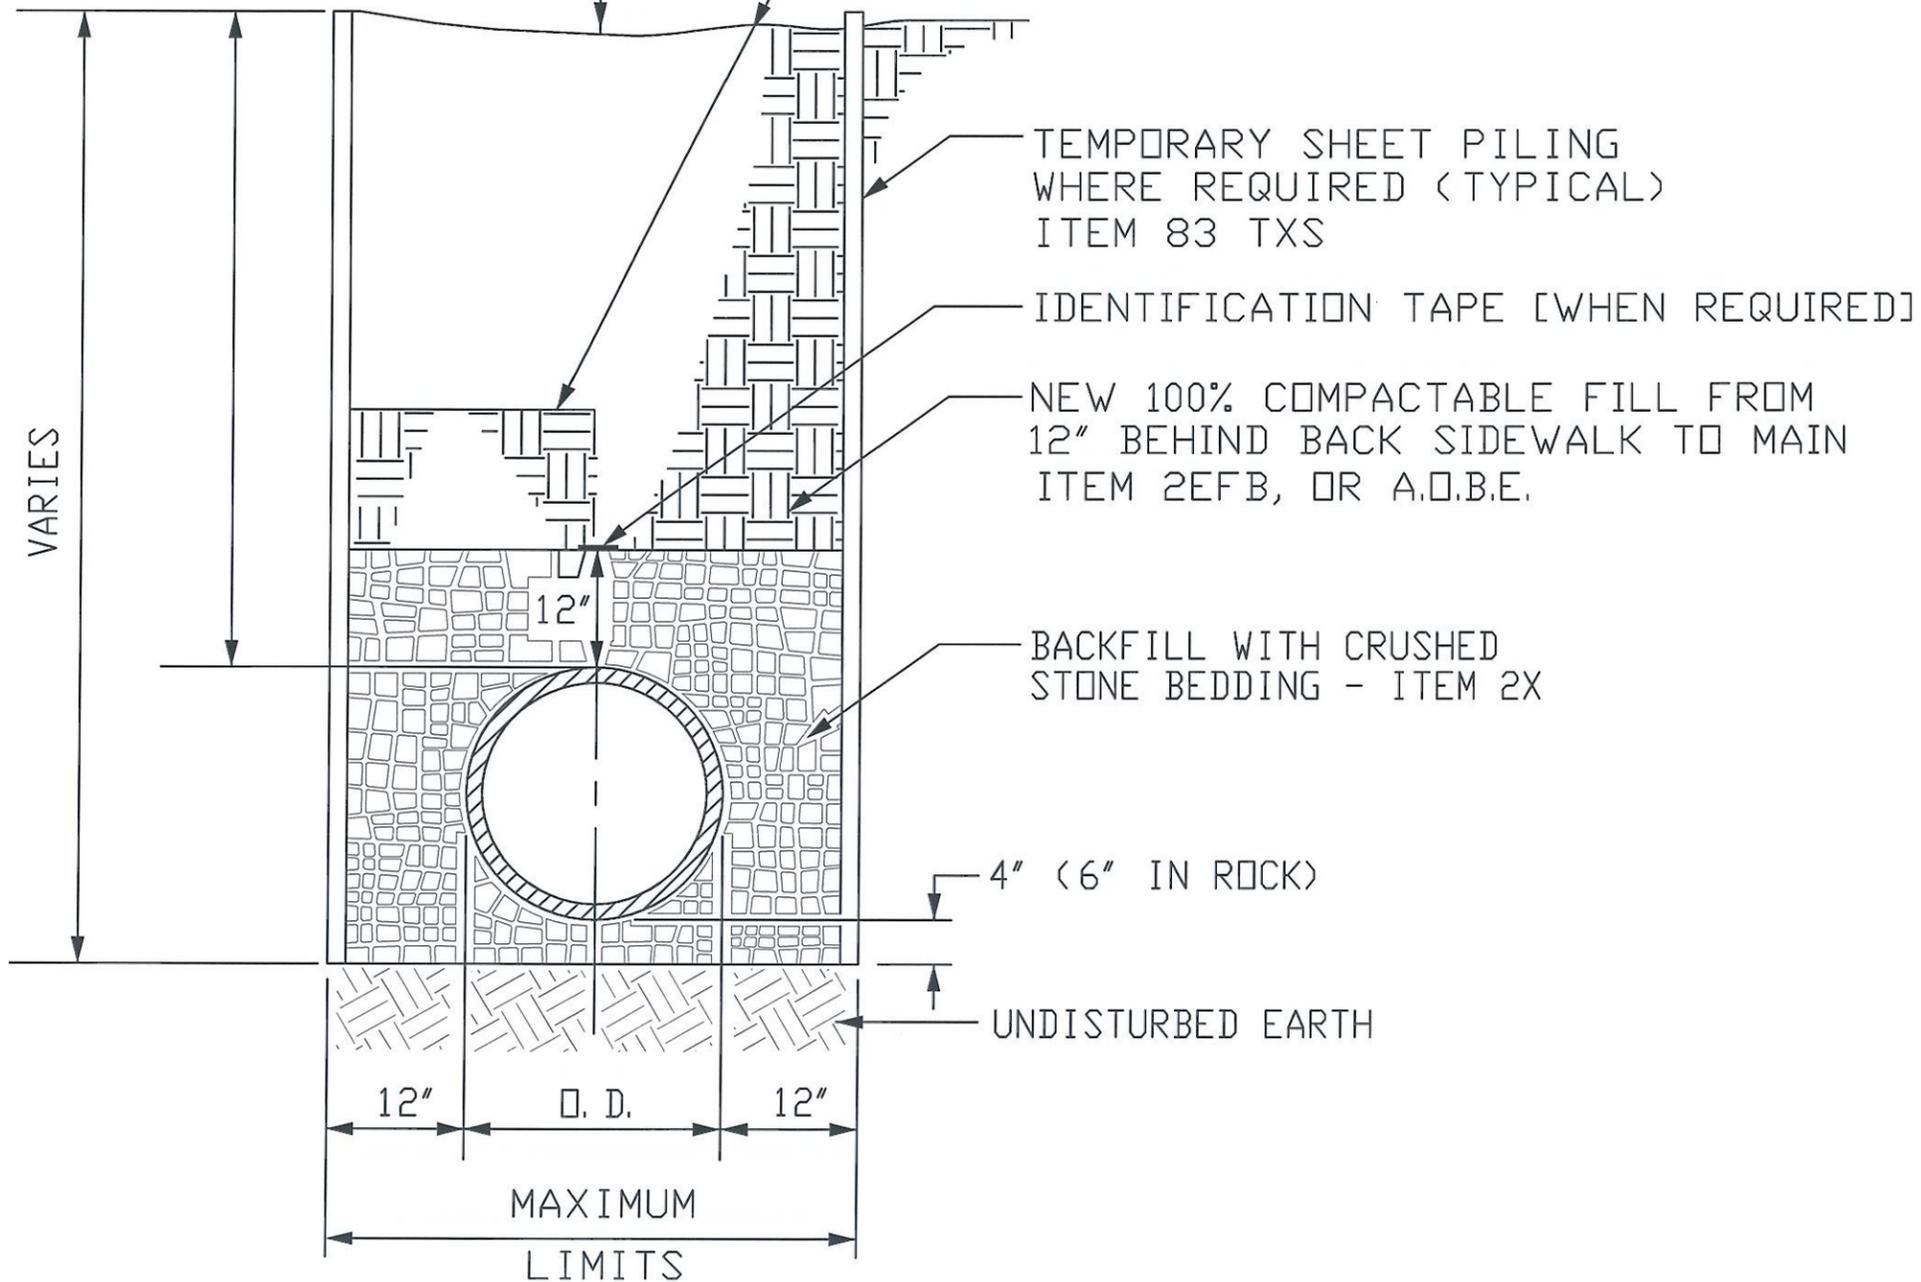

DETAIL  
EXCAVATION AND BACKFILL  
FOR PIPES UNDER 24" DIA.  
NOT UNDER PAVEMENT

NOT TO SCALE